


SCREW TYPE VALVE BOX (USF 7500 O.A.E) WITH
 "STAY HOME" VALVE BOX COVER HAVING RAISED LETTERS,
 "SEWER" CAST IN TOP (SEE VALVE & BOX DETAIL G-3)

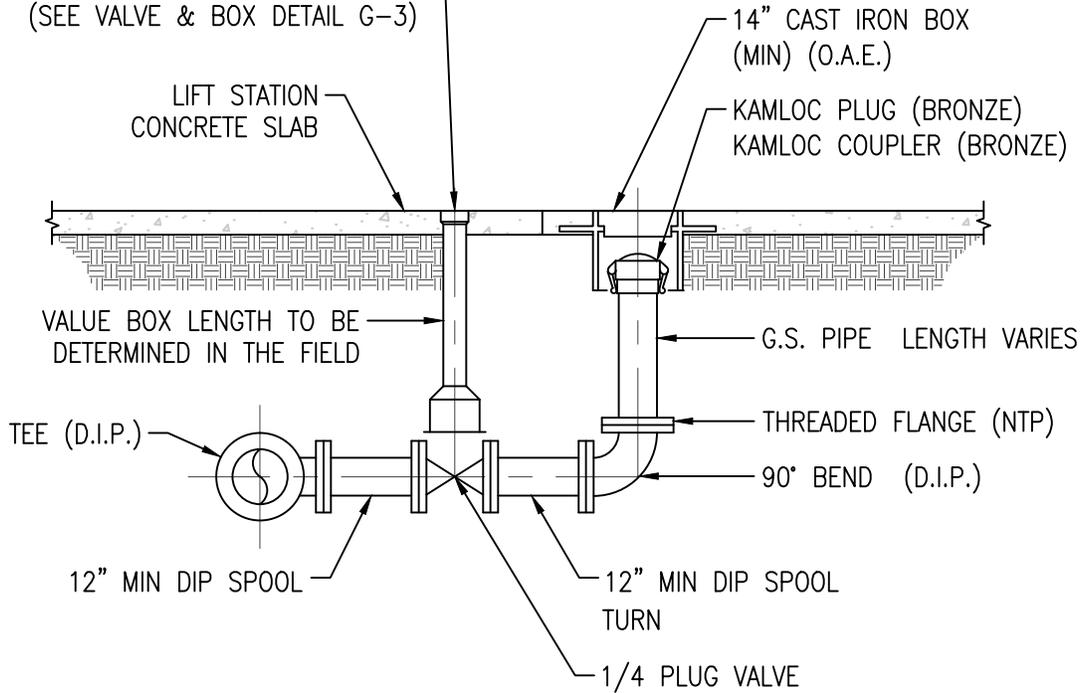

NOTES:

1. MECHANICAL JOINT PIPE WITH TIE RODS OR RESTRAINED JOINTS MAY BE USED WITH THE APPROVAL OF THE UTILITY ENGINEER.
2. EMERGENCY BY-PASS PIPING SHALL BE 4" (MINIMUM) D.I.P.

CITY OF PEMBROKE PINES
 ENGINEERING/UTILITIES DIVISION

STANDARD SANITARY
 SEWER DETAIL


APPROVED: K.M.K.

REVISED: _____

DATE: 02/22/17

 08/01/17

LIFT STATION EMERGENCY
 BY-PASS AND ISOLATION DETAIL



S-13