



2" GALV. STEEL PIPE (PIPE JOINT COMPOUND SHALL BE APPLIED TO MALE THREADS ONLY AND COAT ALL EXPOSED THREADS WITH BITUMASTIC.)

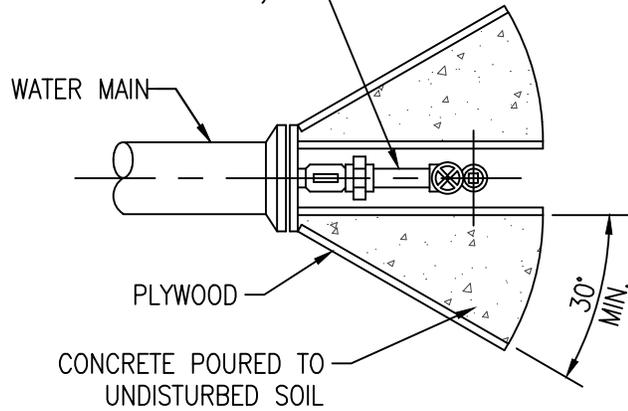

CONCRETE AND PLYWOOD TO HAVE A HEIGHT EQUAL TO THE DIAMETER OF THE PIPE

PLAN

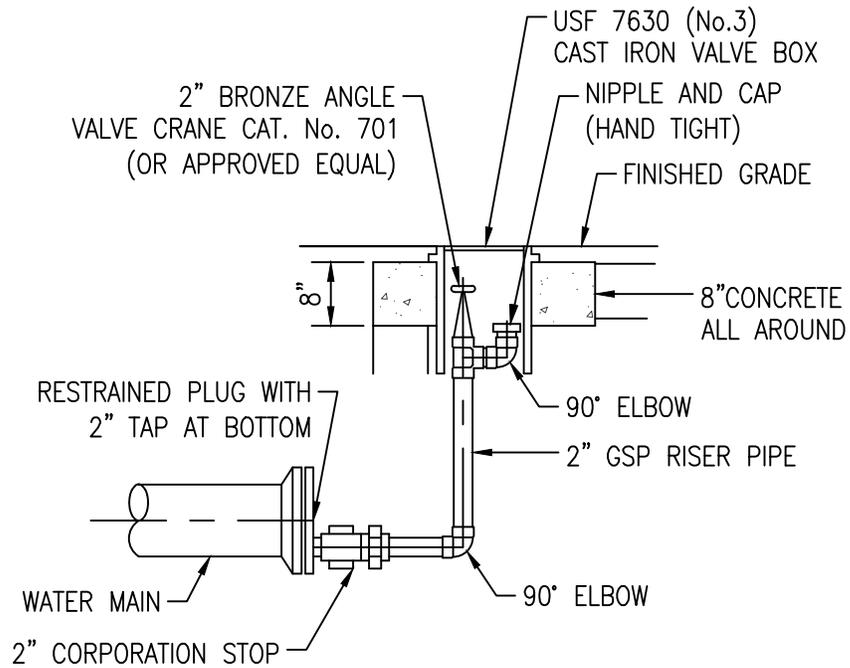

ELEVATION


CITY OF PEMBROKE PINES
ENGINEERING/UTILITIES DIVISION

STANDARD WATER
DISTRIBUTION DETAIL

APPROVED: J.M.
DATE: 11/05/99

REVISED:

2" TERMINAL BLOW-OFF



W-5