


NOTES:

1. TOP OF CAP TO BE 1' ABOVE THE BASIN CONTROL ELEVATION FOR LAKES AND 2' ABOVE BASIN CONTROL ELEVATION FOR CANALS, UNLESS OTHERWISE APPROVED BY THE DISTRICT.
2. REQUIRED FOR ALL LAKE AND CANAL INTERCONNECTS.
3. CONCRETE AND RIP-RAP ENDWALLS ARE ACCEPTED PER FDOT INDEX 250-255 AND INDEX 258.

TYPICAL HEADWALL DETAIL

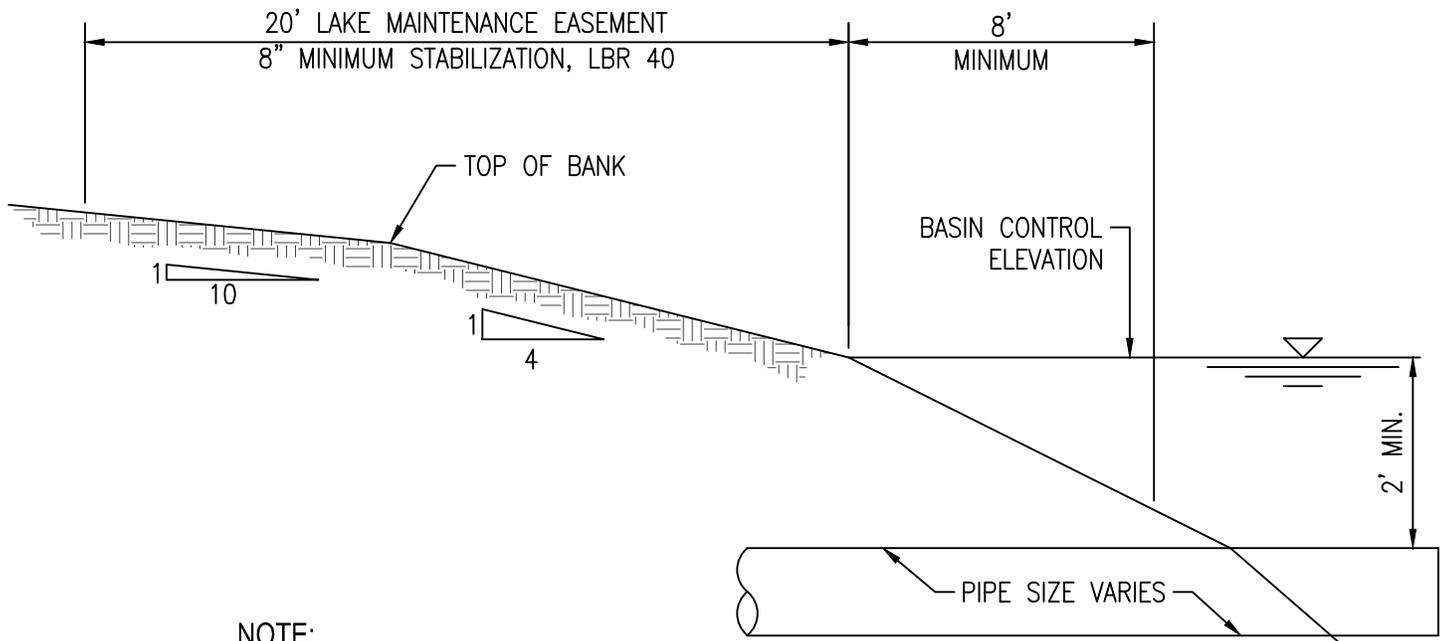

NOTE:

1. OUTFALLS SHALL EXTEND PAST DEEP CUT LINE OF LAKES NO LESS THAN 2 FEET AND NO MORE THAN 5 FEET.

TYPICAL LAKE OUTFALL DETAIL

CITY OF PEMBROKE PINES ENGINEERING/UTILITIES DIVISION		STANDARD DRAINAGE DETAIL			<h1>D-10</h1>
APPROVED: J.M.	REVISD:	TYPICAL HEADWALL TYPICAL LAKE OUTFALL			
DATE: 11/05/99					